



Test Certificate No. 7213211446

1. Details of order:

The test was order by: TÜV Rheinland (Shanghai) Co., Ltd

Address: TÜV Building I, No.177, Lane 777, West Guangzhong Road Jingan District, Shanghai, China

Date of order: 19.05.2022

The sample was taken by a representative of the customer

2. Test of:

Photovoltaic module

Model : EG-XXXM72-HLV

Manufacturer : Changzhou EGing Photovoltaic Technology Co., Ltd.

Country of manufacture : CHINA

Module type : Mono-crystalline

Num. of cells in module : 144

Overall dimensions : 2286/2279/2278 mm X 1134 mm X 40/35 mm

3. Description of sample:

Date of Sampling : 05.05.2022

Sampling By : Customer

Number of Sampling : 1

4. Nature of Test:

Compliance of the model with the requirements of the International Standards:

IEC 61730 - Photovoltaic (PV) module safety qualification

Part 1: clauses 3,4,5,6,7,8,9,10,11,12

Part 2: clauses 3,6,9,10,11

SI 61215 - Crystalline silicon terrestrial photovoltaic (PV) modules :

clause 10.17 (Hail test) Design qualification and type approval.

5. Conclusion:

The module complies with the requirements of the clauses to which they were tested.

Notes: This example is representative for sample modules: **EG-XXXM72-HLV** (XXX=530-550), IEC1500V.

Test report Lab.: TUV RHEINLAND, Test Report No.: 50116992 001-026


This document alone is not used to release goods from customs.

This report refers only to the sample tested and does not refer to other samples of the same product.

This document contains 6 pages, and may be used only in full.

Matthew Skif

Laboratory Technician



01/06/2022

Test Completion Date: 01.06.2022

6.3.18 / א' 32.7.707 מרמט



Test Certificate No. 7213211446

6. Tests Results:**Standard IEC 617301 Part 1**

No.	Subject	Results and details of nonconformance	Verdict
3	Application classes		P
4	Construction requirements		P
5	Polymeric material		P
6	Internal wiring and current – carrying parts		P
7	Connections		P
8	Bonding and grounding		P
9	Creepage and clearance distances		P
10	Field wiring compartments with covers		P
11	Marking		P
12	Requirements for supplied documents		P

Test Completion Date: 01.06.2022

מס' תיקון 32.7.707 מהדורה א', 6.3.18



Test Certificate No. 7213211446

Standard IEC 617301 Part 2

No.	Subject and details of nonconformance		Results	Verdict
6	Sampling			P
9	Pass criteria			P
10				P
	Test procedures	+ Tested in practice	MST 01	P
			MST 11	P
			MST 12	P
		Double insulation	MST 13	P
			MST 14	P
			MST 15	P
		Tested in practice >100 MΩ, 8 kV DC	MST 16	P
			MST 17	P
			MST 21	P
			MST 23	P
			MST 26	P
			MST 32	P
11				P
	Component tests		MST 15	P
			MST 33	P
			MST 44	P

Standard IEC 61215

4.1	Hail test	This paragraph is tested in accordance with the method defined in UL Standard 1703 .	P
-----	-----------	--	---

Test Completion Date: 01.06.2022


מחלקת מכניקה ו' 6.3.18 32.7.707



Test Certificate No. 7213211446

Appendix 1

Photo Documentation

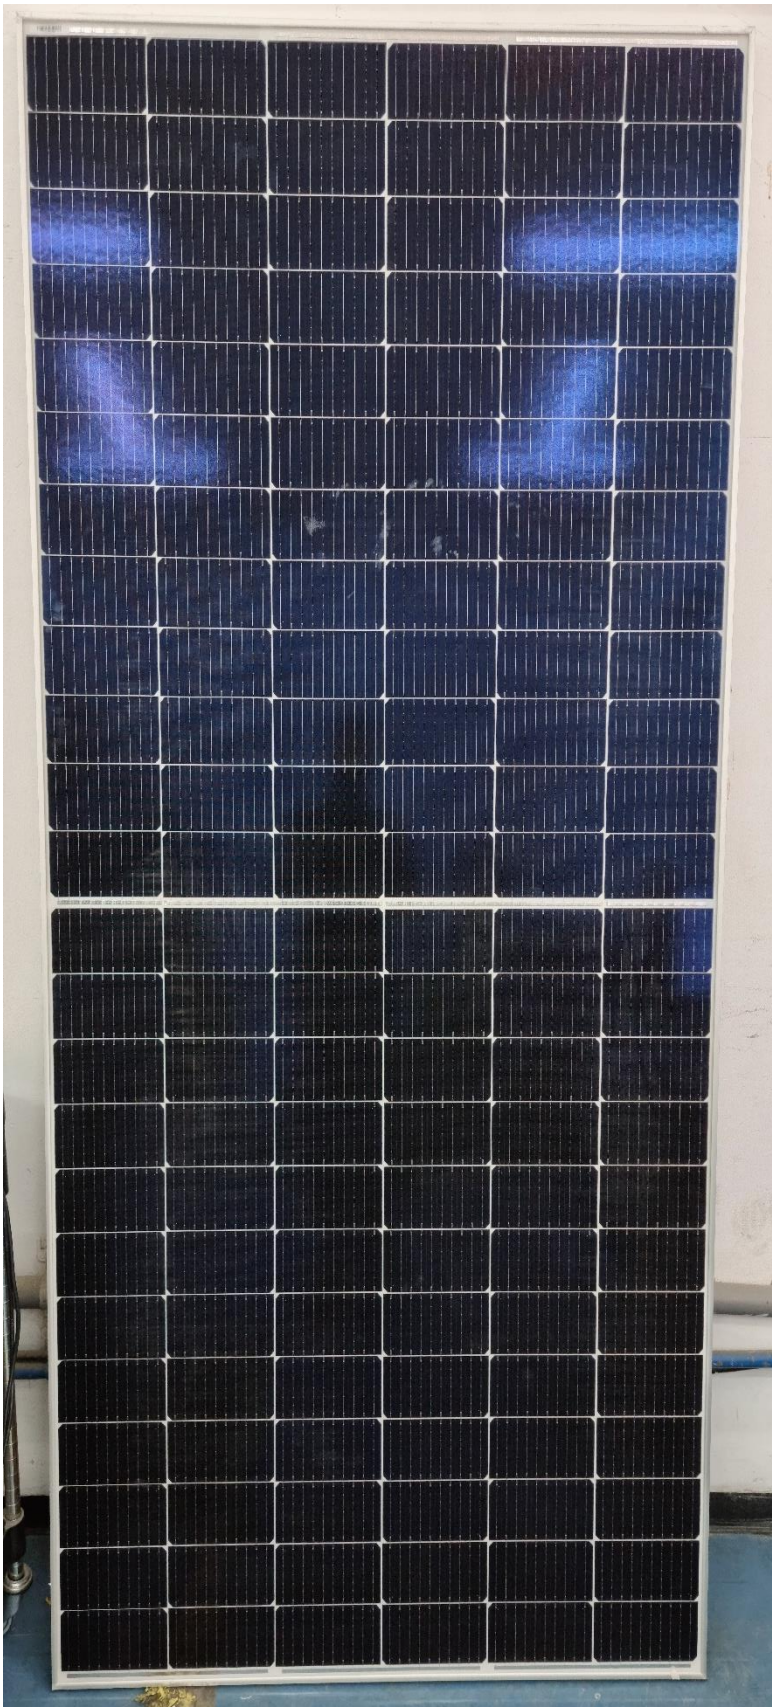


Test Completion Date: 01.06.2022

פרוט 32.7.707 מהדורה א' / 6.3.18

Test Certificate No. 7213211446


		PHOTOVOLTAIC MODULE	
		MODEL: EG-540M72-HLV	
Standard Test Condition: 1000W/m ² AM1.5 25°C			
Pmax	540W ^(0~+3%)	Isc	13.60A
Vmp	42.03V	Cells	144pcs
Imp	12.85A	Weight	27.0kg
Voc	49.89V	Sys.Volt.	1500V
Size of module		2278×1134×35mm	
Fuse Rating		25A	
Module Application		Class A	
WARNING Please follow the instruction manual during installation or maintenance. Do not connect or disconnect the connectors under load current.			
Certified in accordance with IEC61215(ed.2) IEC61730-1,-2			
<small>Place of manufacturing: Changzhou Eging Photovoltaic Technology Co., Ltd No. 18, Jinwu Road, Jintan, Changzhou, Jiangsu Province, P. R. C 213213 Made in China</small>			

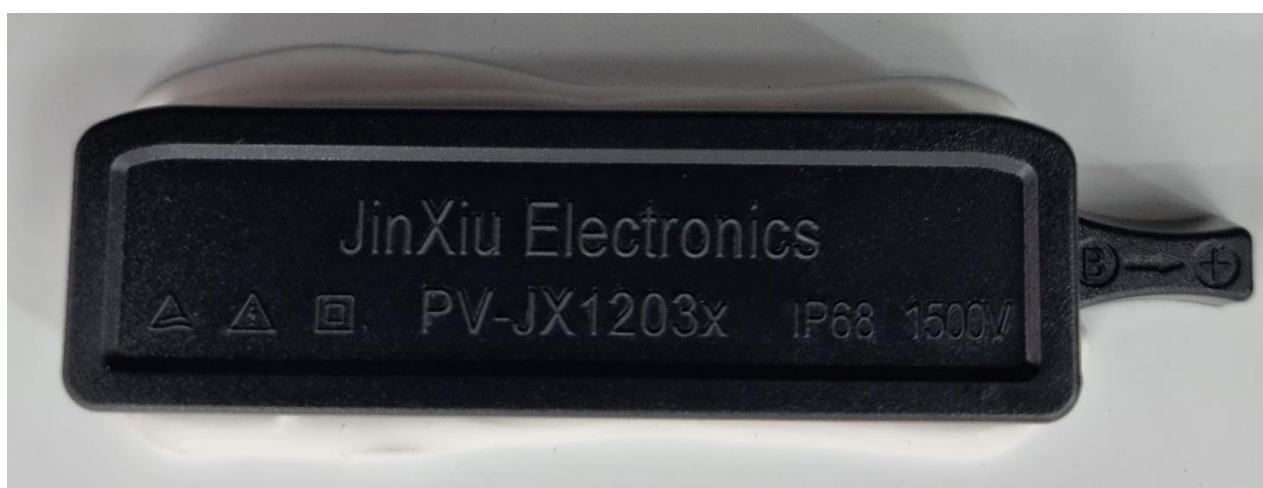

Test Completion Date: 01.06.2022

מסמט 32.7.707 מהדורה א' / 6.3.18

Test Certificate No. 7213211446

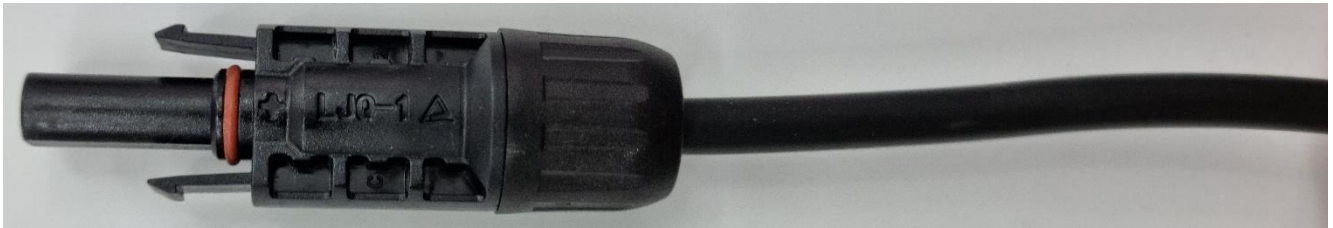

Test Completion Date: 01.06.2022

מחלקת מכניקה ו' 32.7.707 6.3.18